

FIG. 1

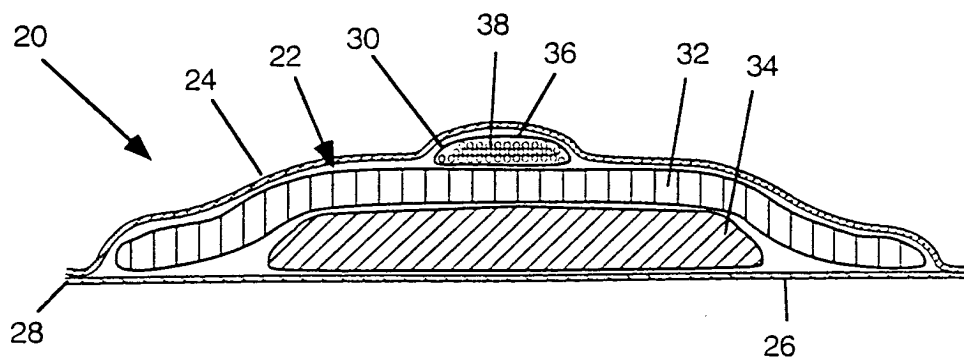


FIG. 2

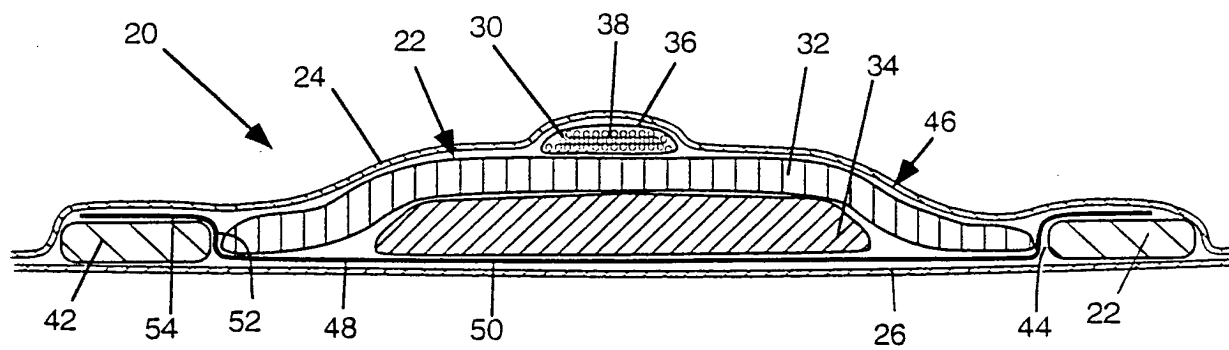


FIG. 3

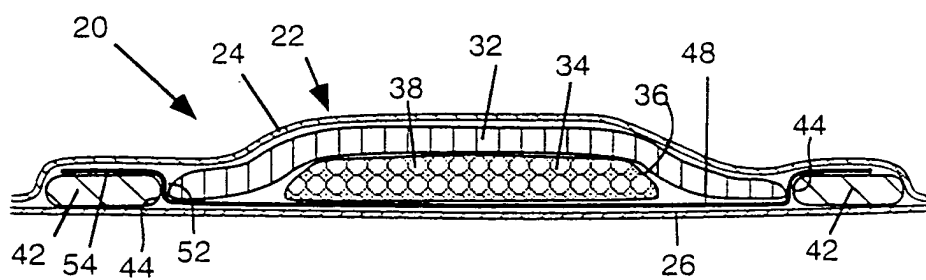


FIG. 4A

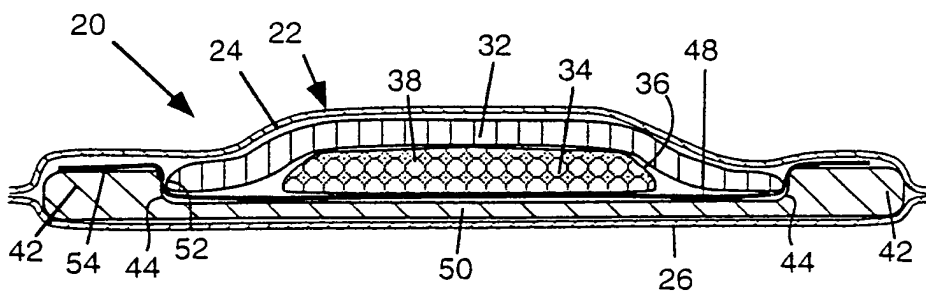


FIG. 4B

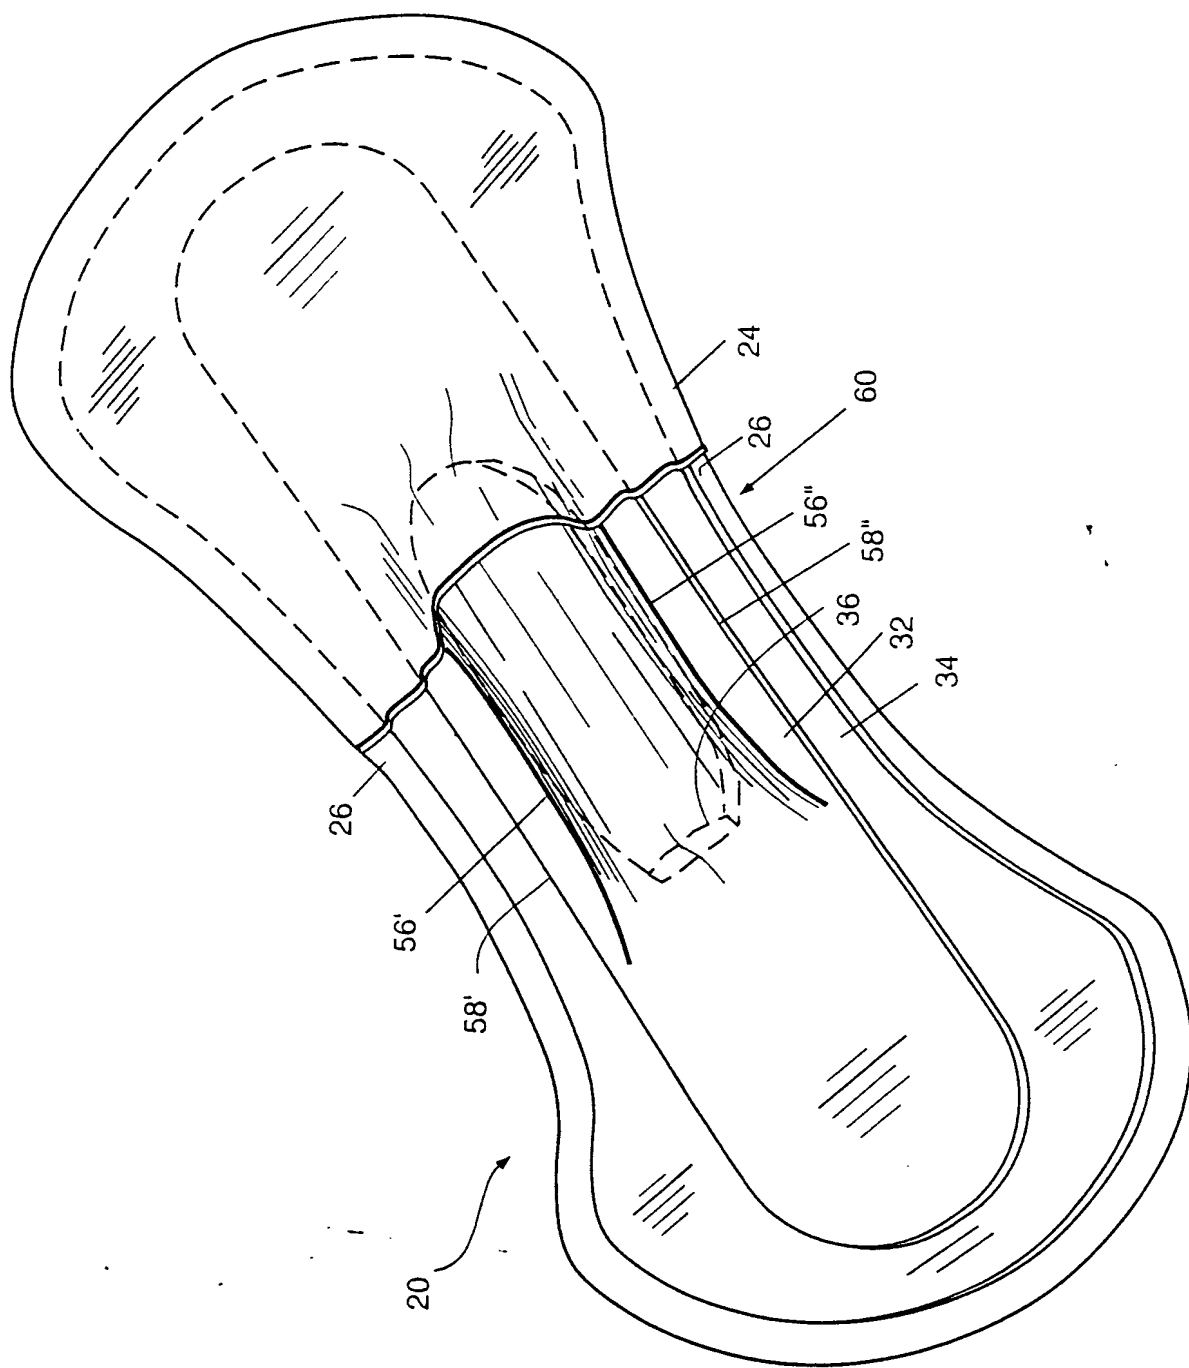


FIG. 5

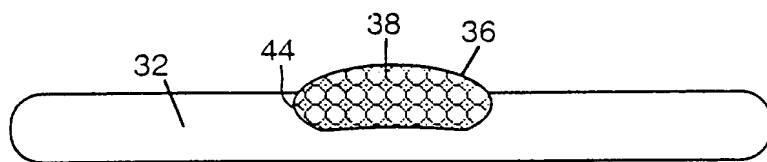


FIG. 6A

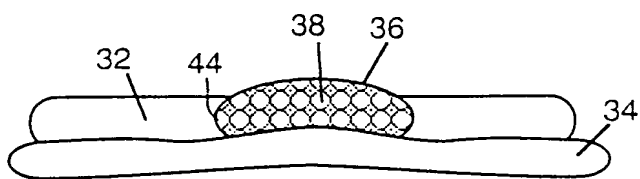


FIG. 6B

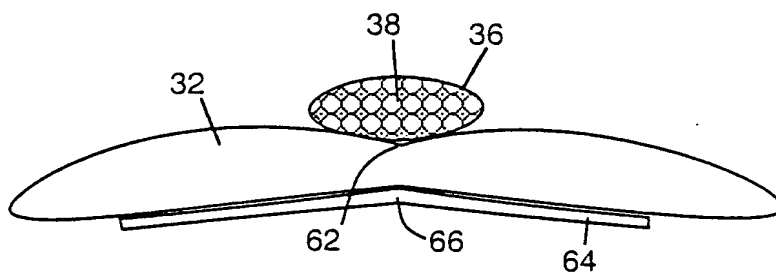


FIG. 6C

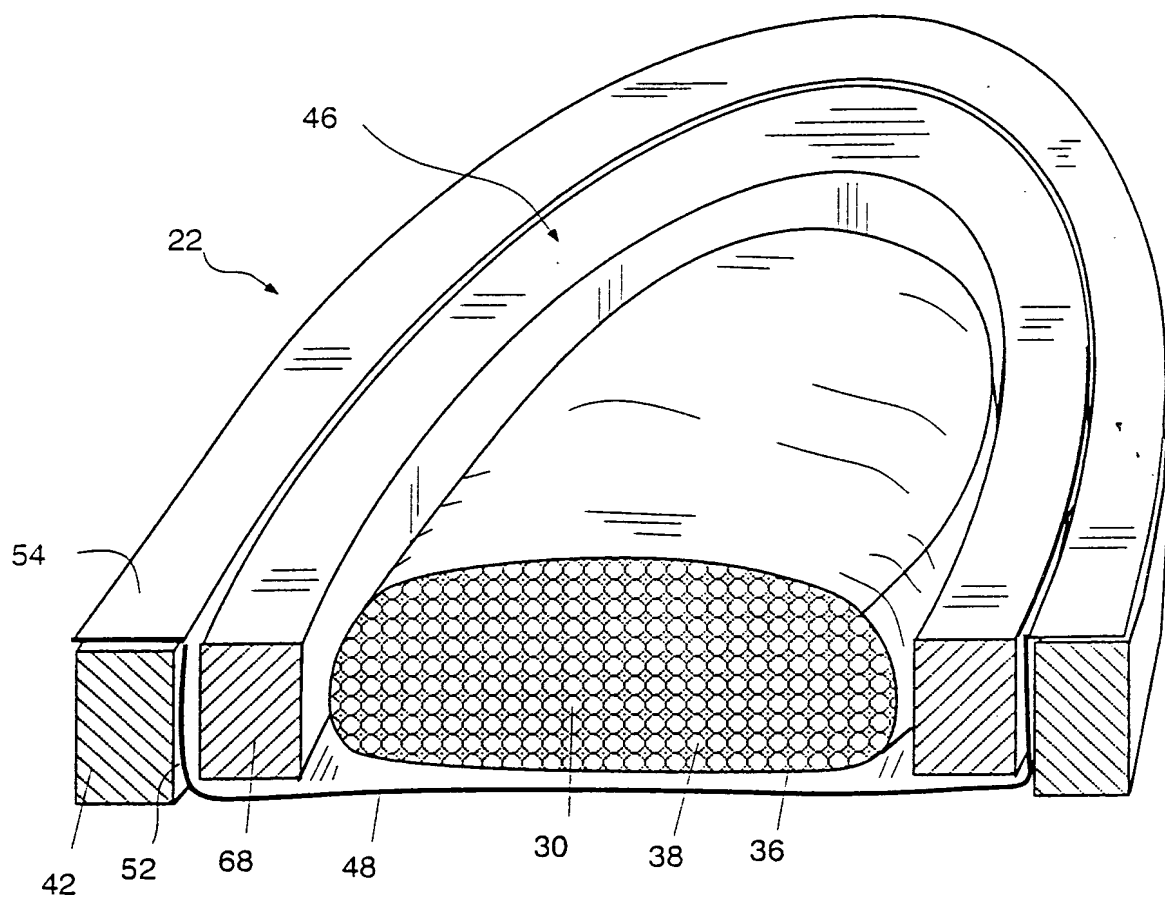


FIG. 7

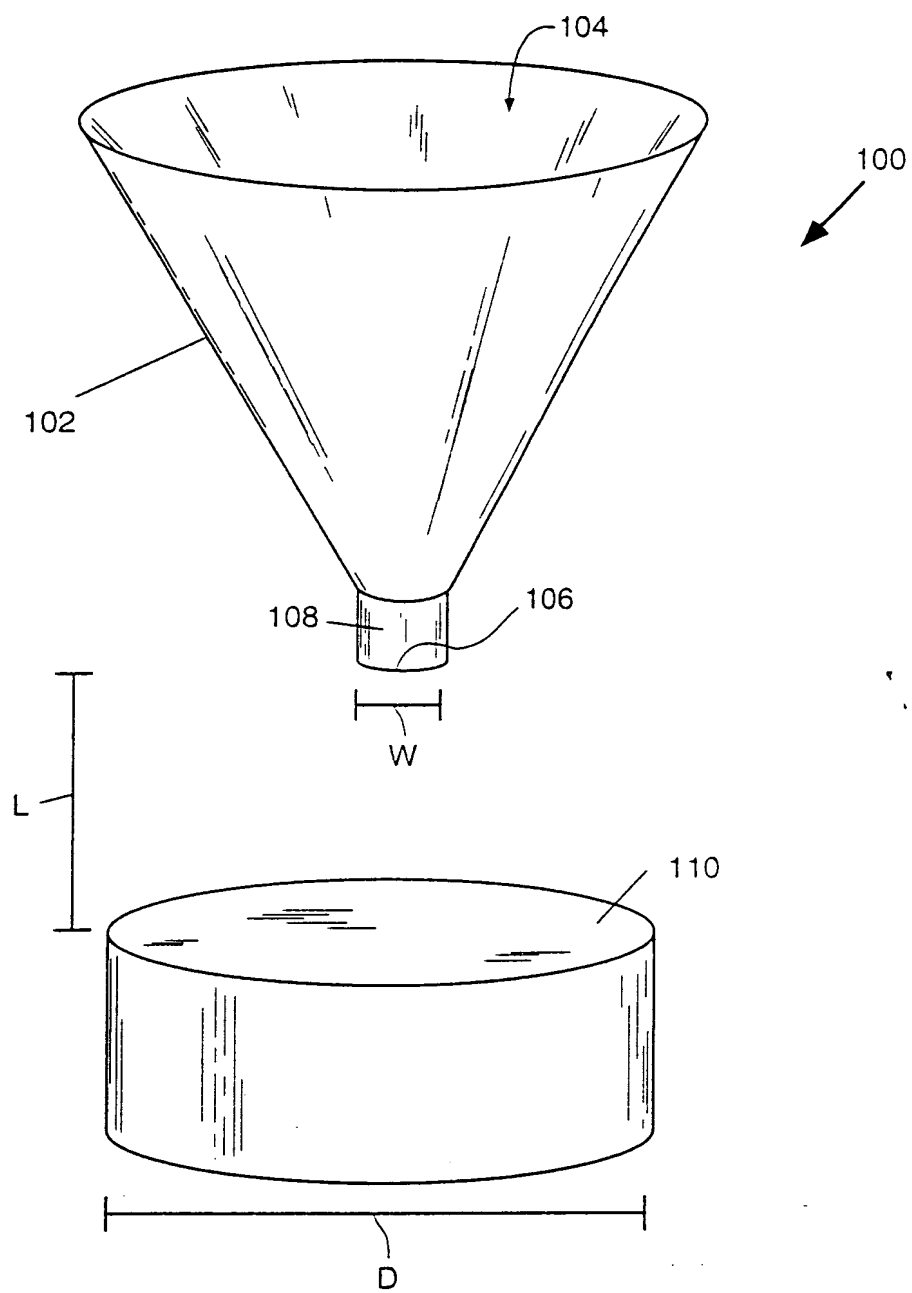


FIG. 9

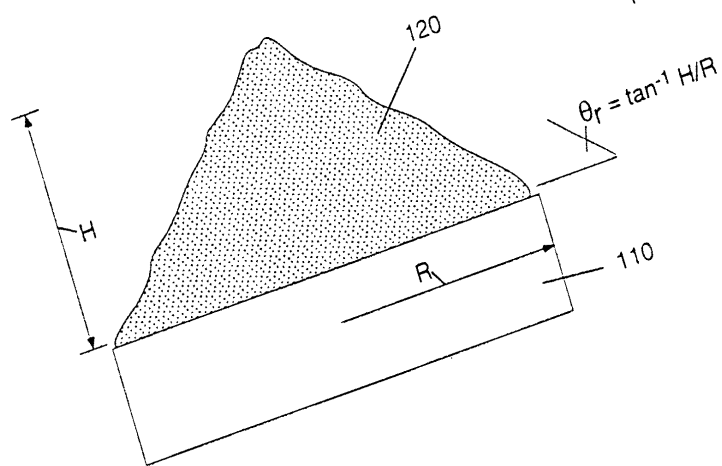


FIG. 10

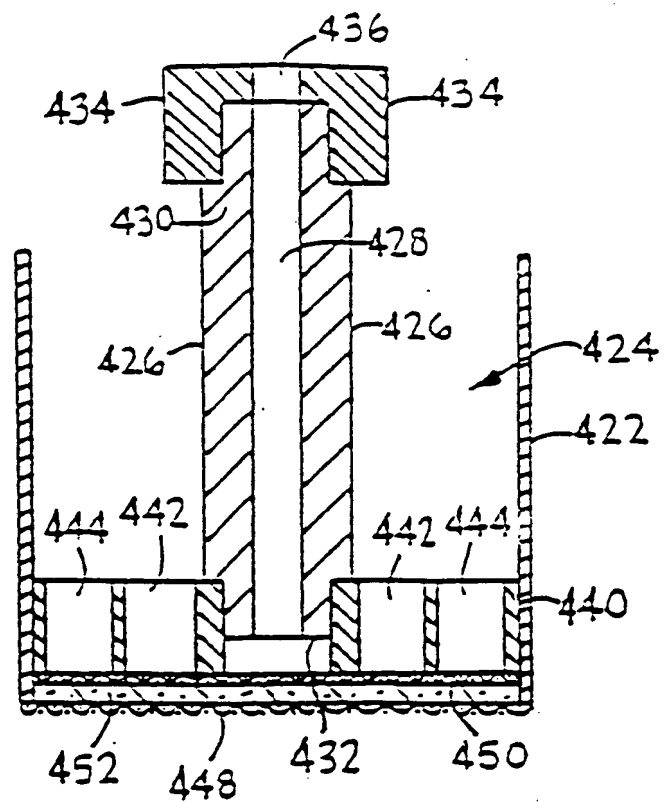


FIG. 11

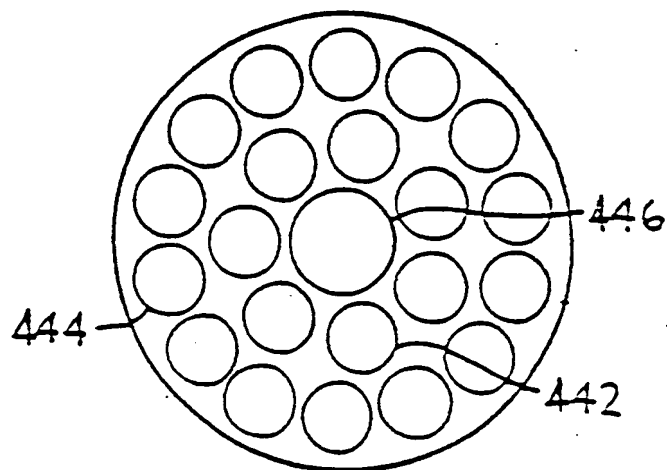


FIG. 12

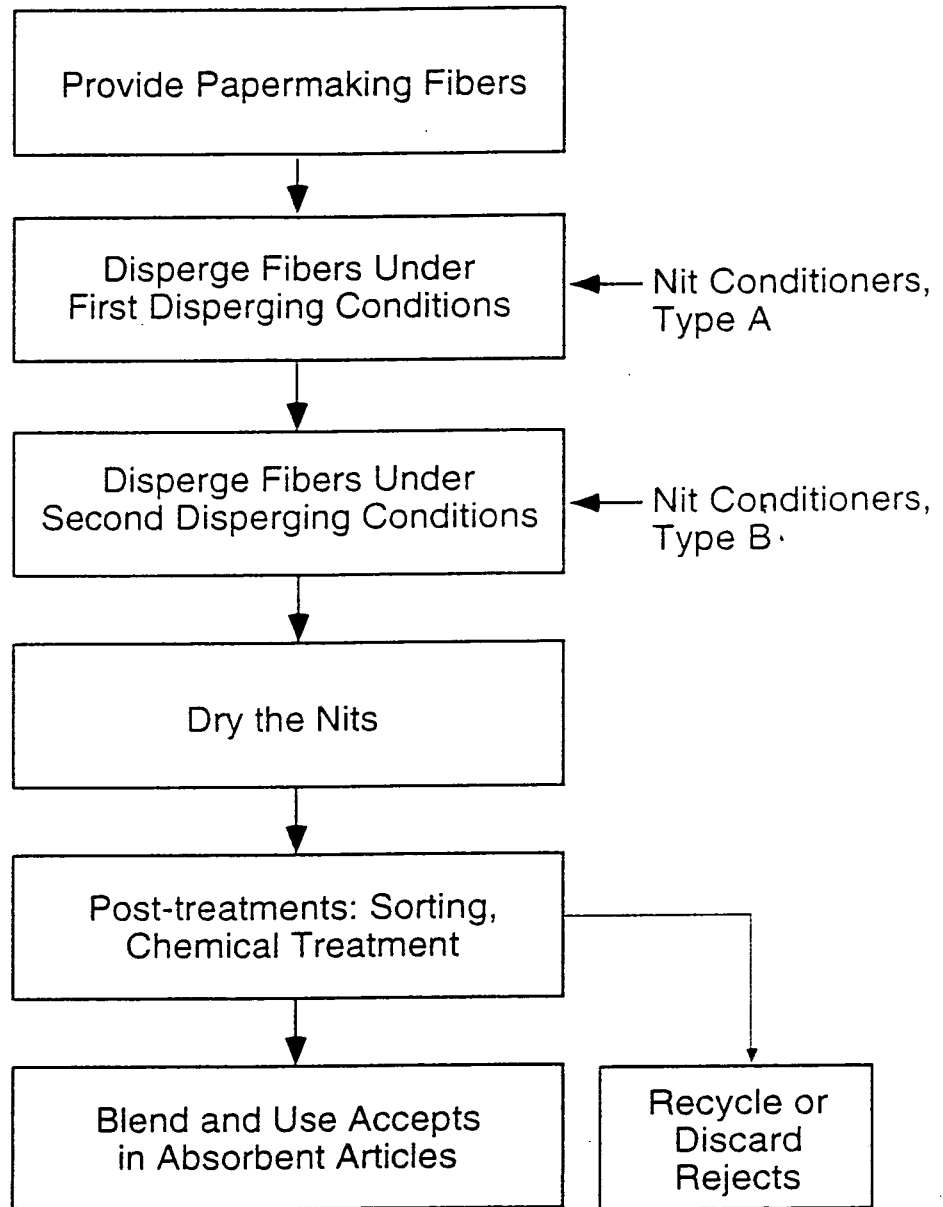


FIG. 13

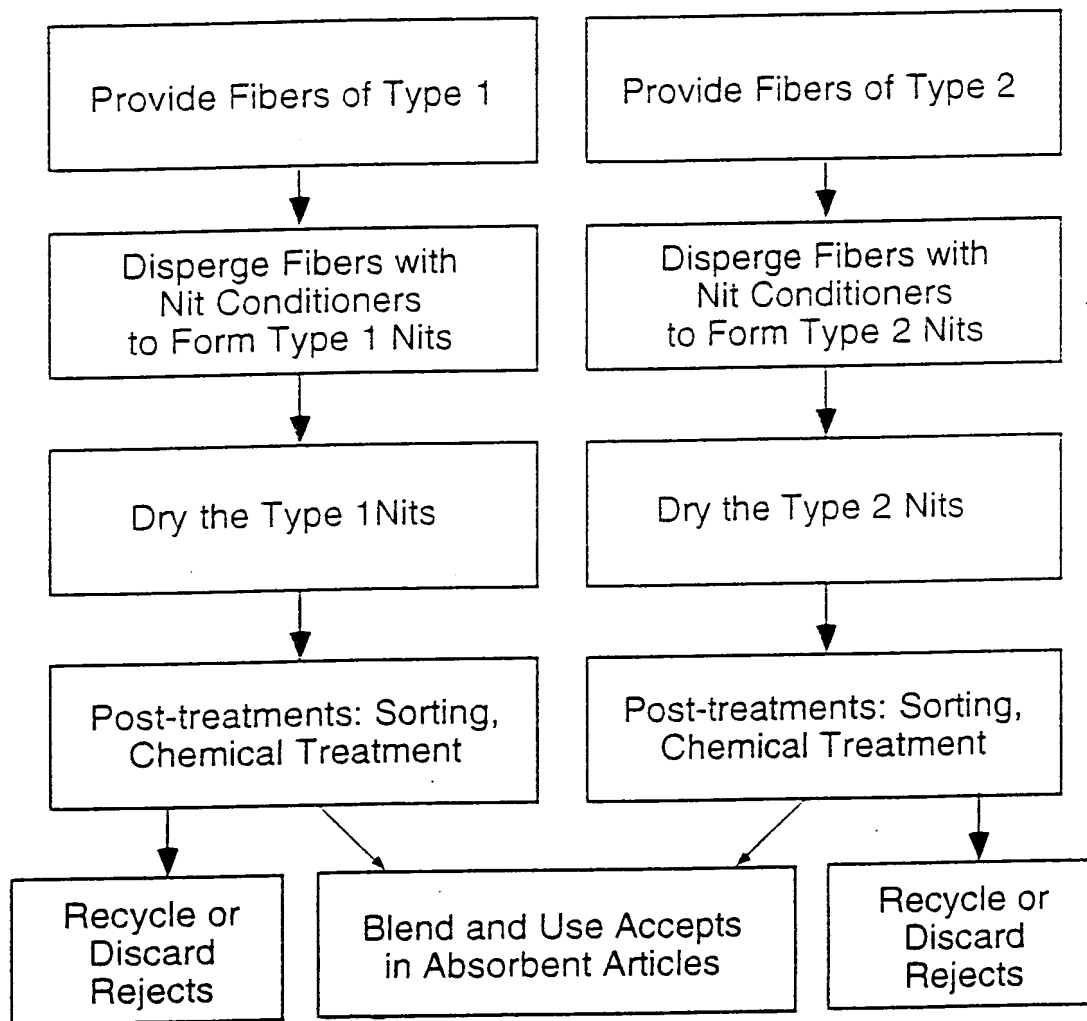


FIG. 14

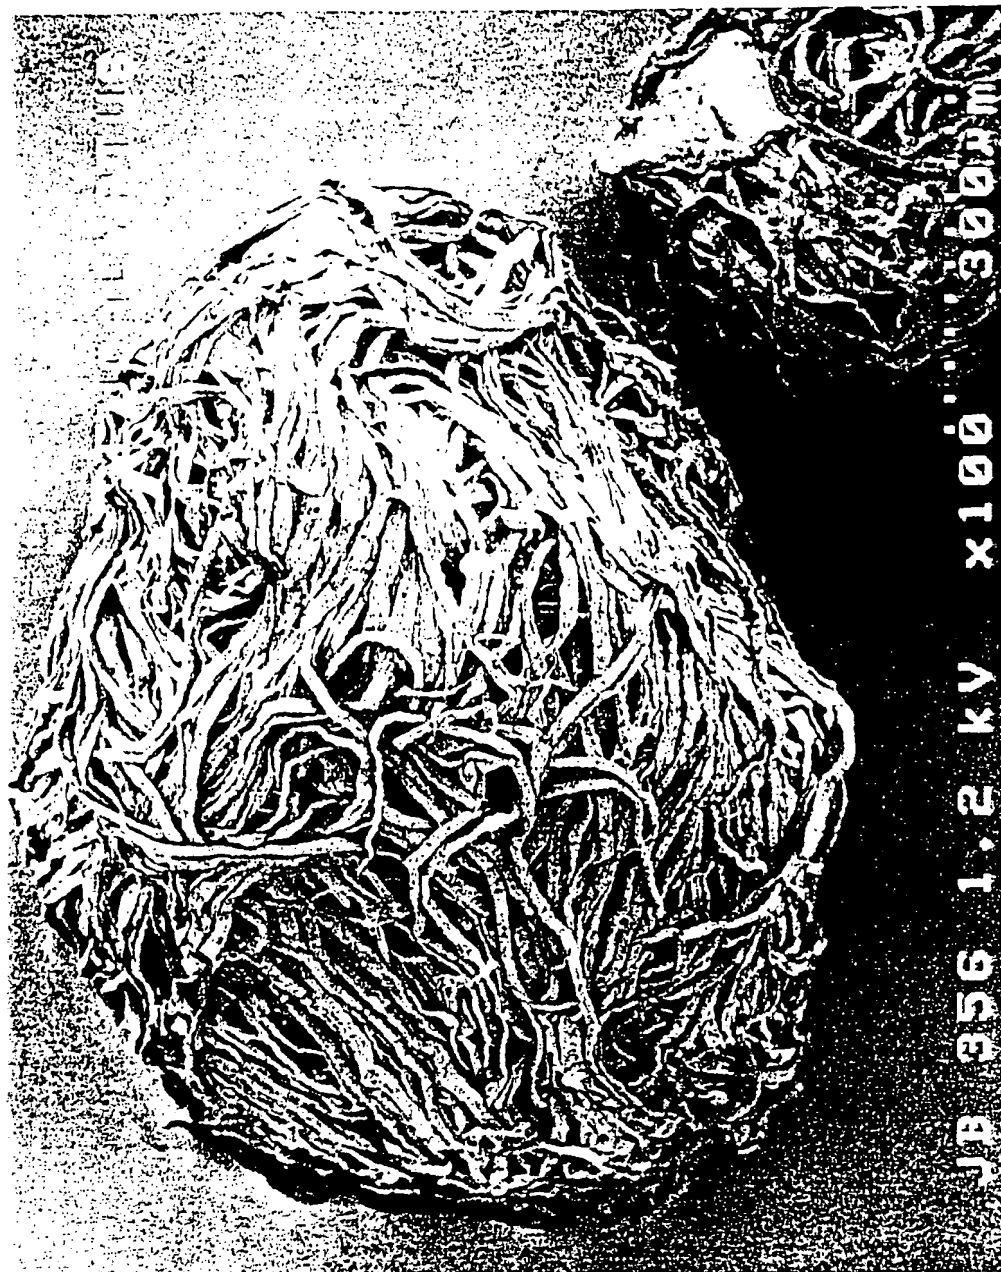


FIG. 15



EUCALYPTUS HTS

450 μm

15. kV 100x GSED 8.24mm 3.7I
Kimberly-Clark Microscopy Lab EUC2.TIF 99/01/26 16:30

FIG. 16

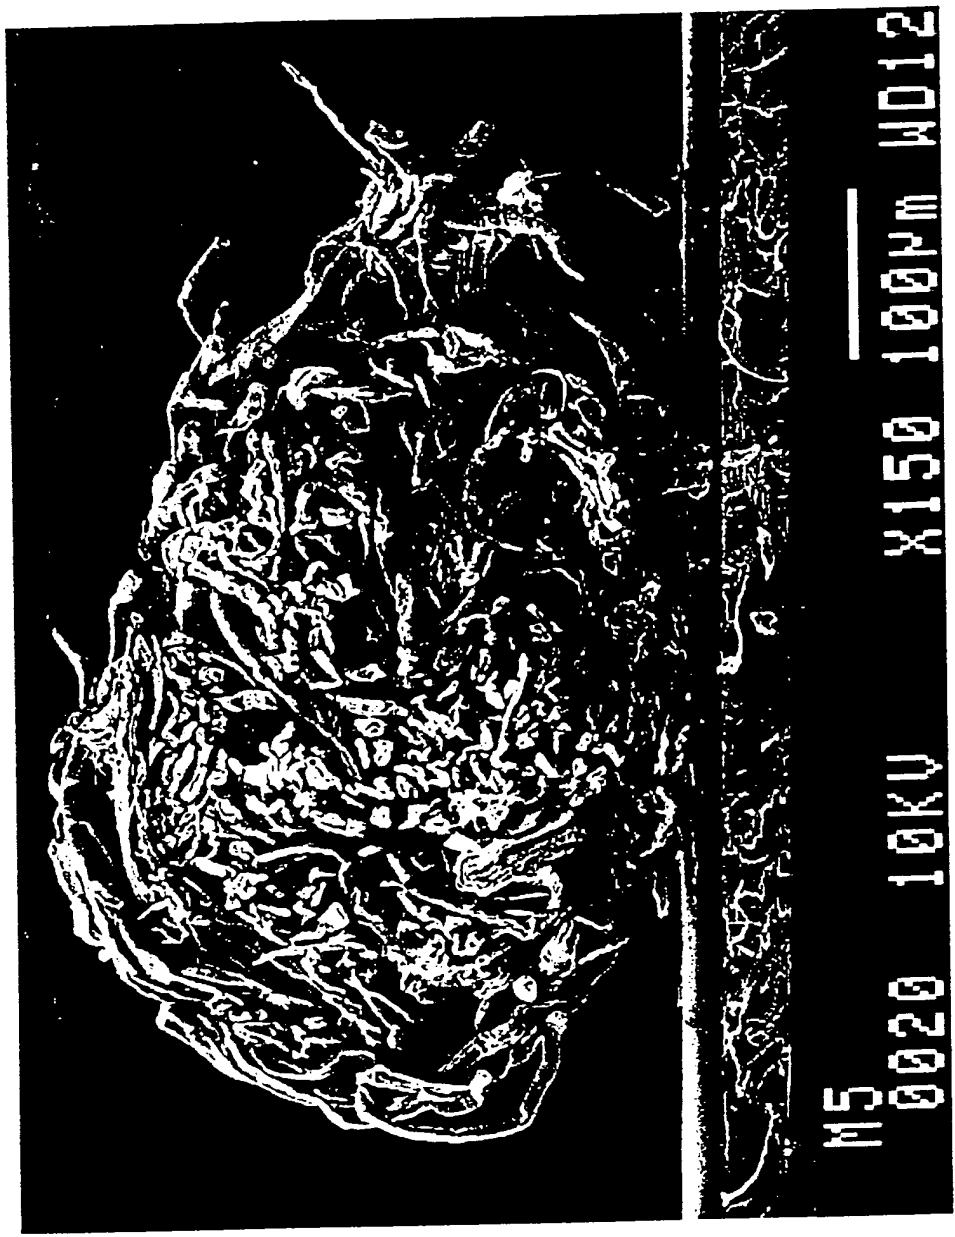


FIG. 17